


ECS0004L

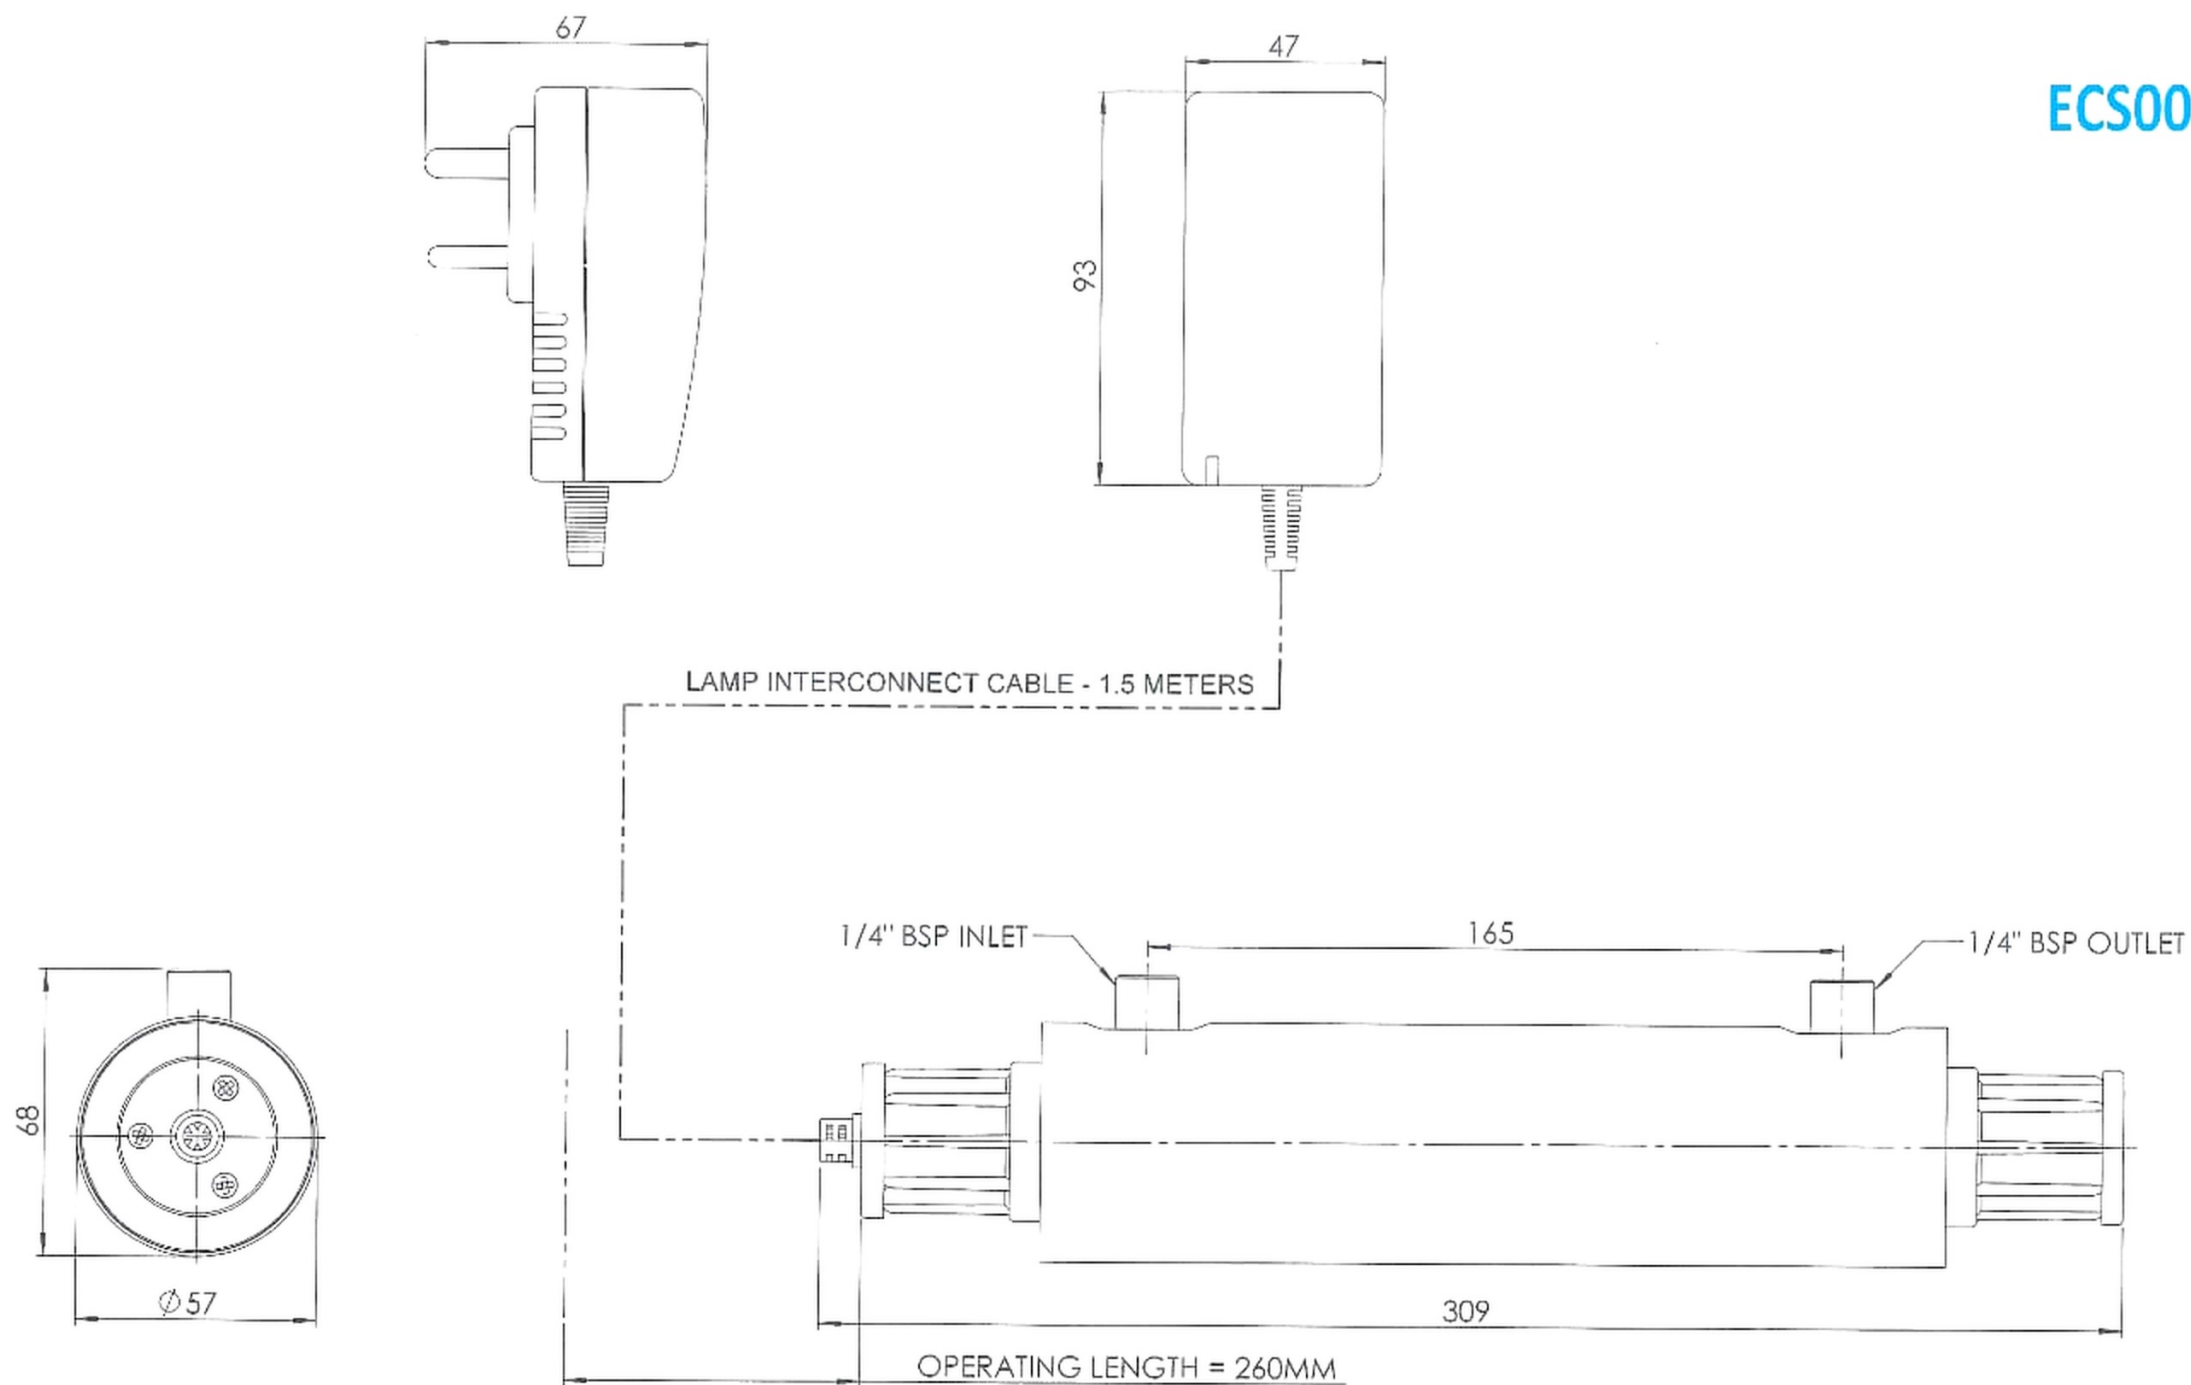

NOTE: DISTANCE BETWEEN POWER SUPPLY AND REACTOR CHAMBER MAY NOT EXCEED 1.5 METERS.

DRAWN BY VAA
 CHECKED BY RJ
 APPROVED BY [Signature]
 DATE 28-07-2015
 SCALE NTS

ECS004L





ALL PROPRIETARY RIGHTS RESERVED. THIS DRAWING SHALL NOT BE REPRODUCED OR IN ANY WAY UTILIZED FOR MANUFACTURE OF THE COMPONENT OR UNIT HEREIN ILLUSTRATED, AND MUST NOT BE RELEASED TO OTHER PARTIES WITHOUT WRITTEN CONSENT FROM ACE HYGIENE PRODUCT PVT. LTD. ANY INFRACTION WILL BE LEGALLY PURSUED.


ACE HYGIENE PRODUCT PVT. LTD., MUMBAI 370419424


SHEET NO. 1 OF 1 A3



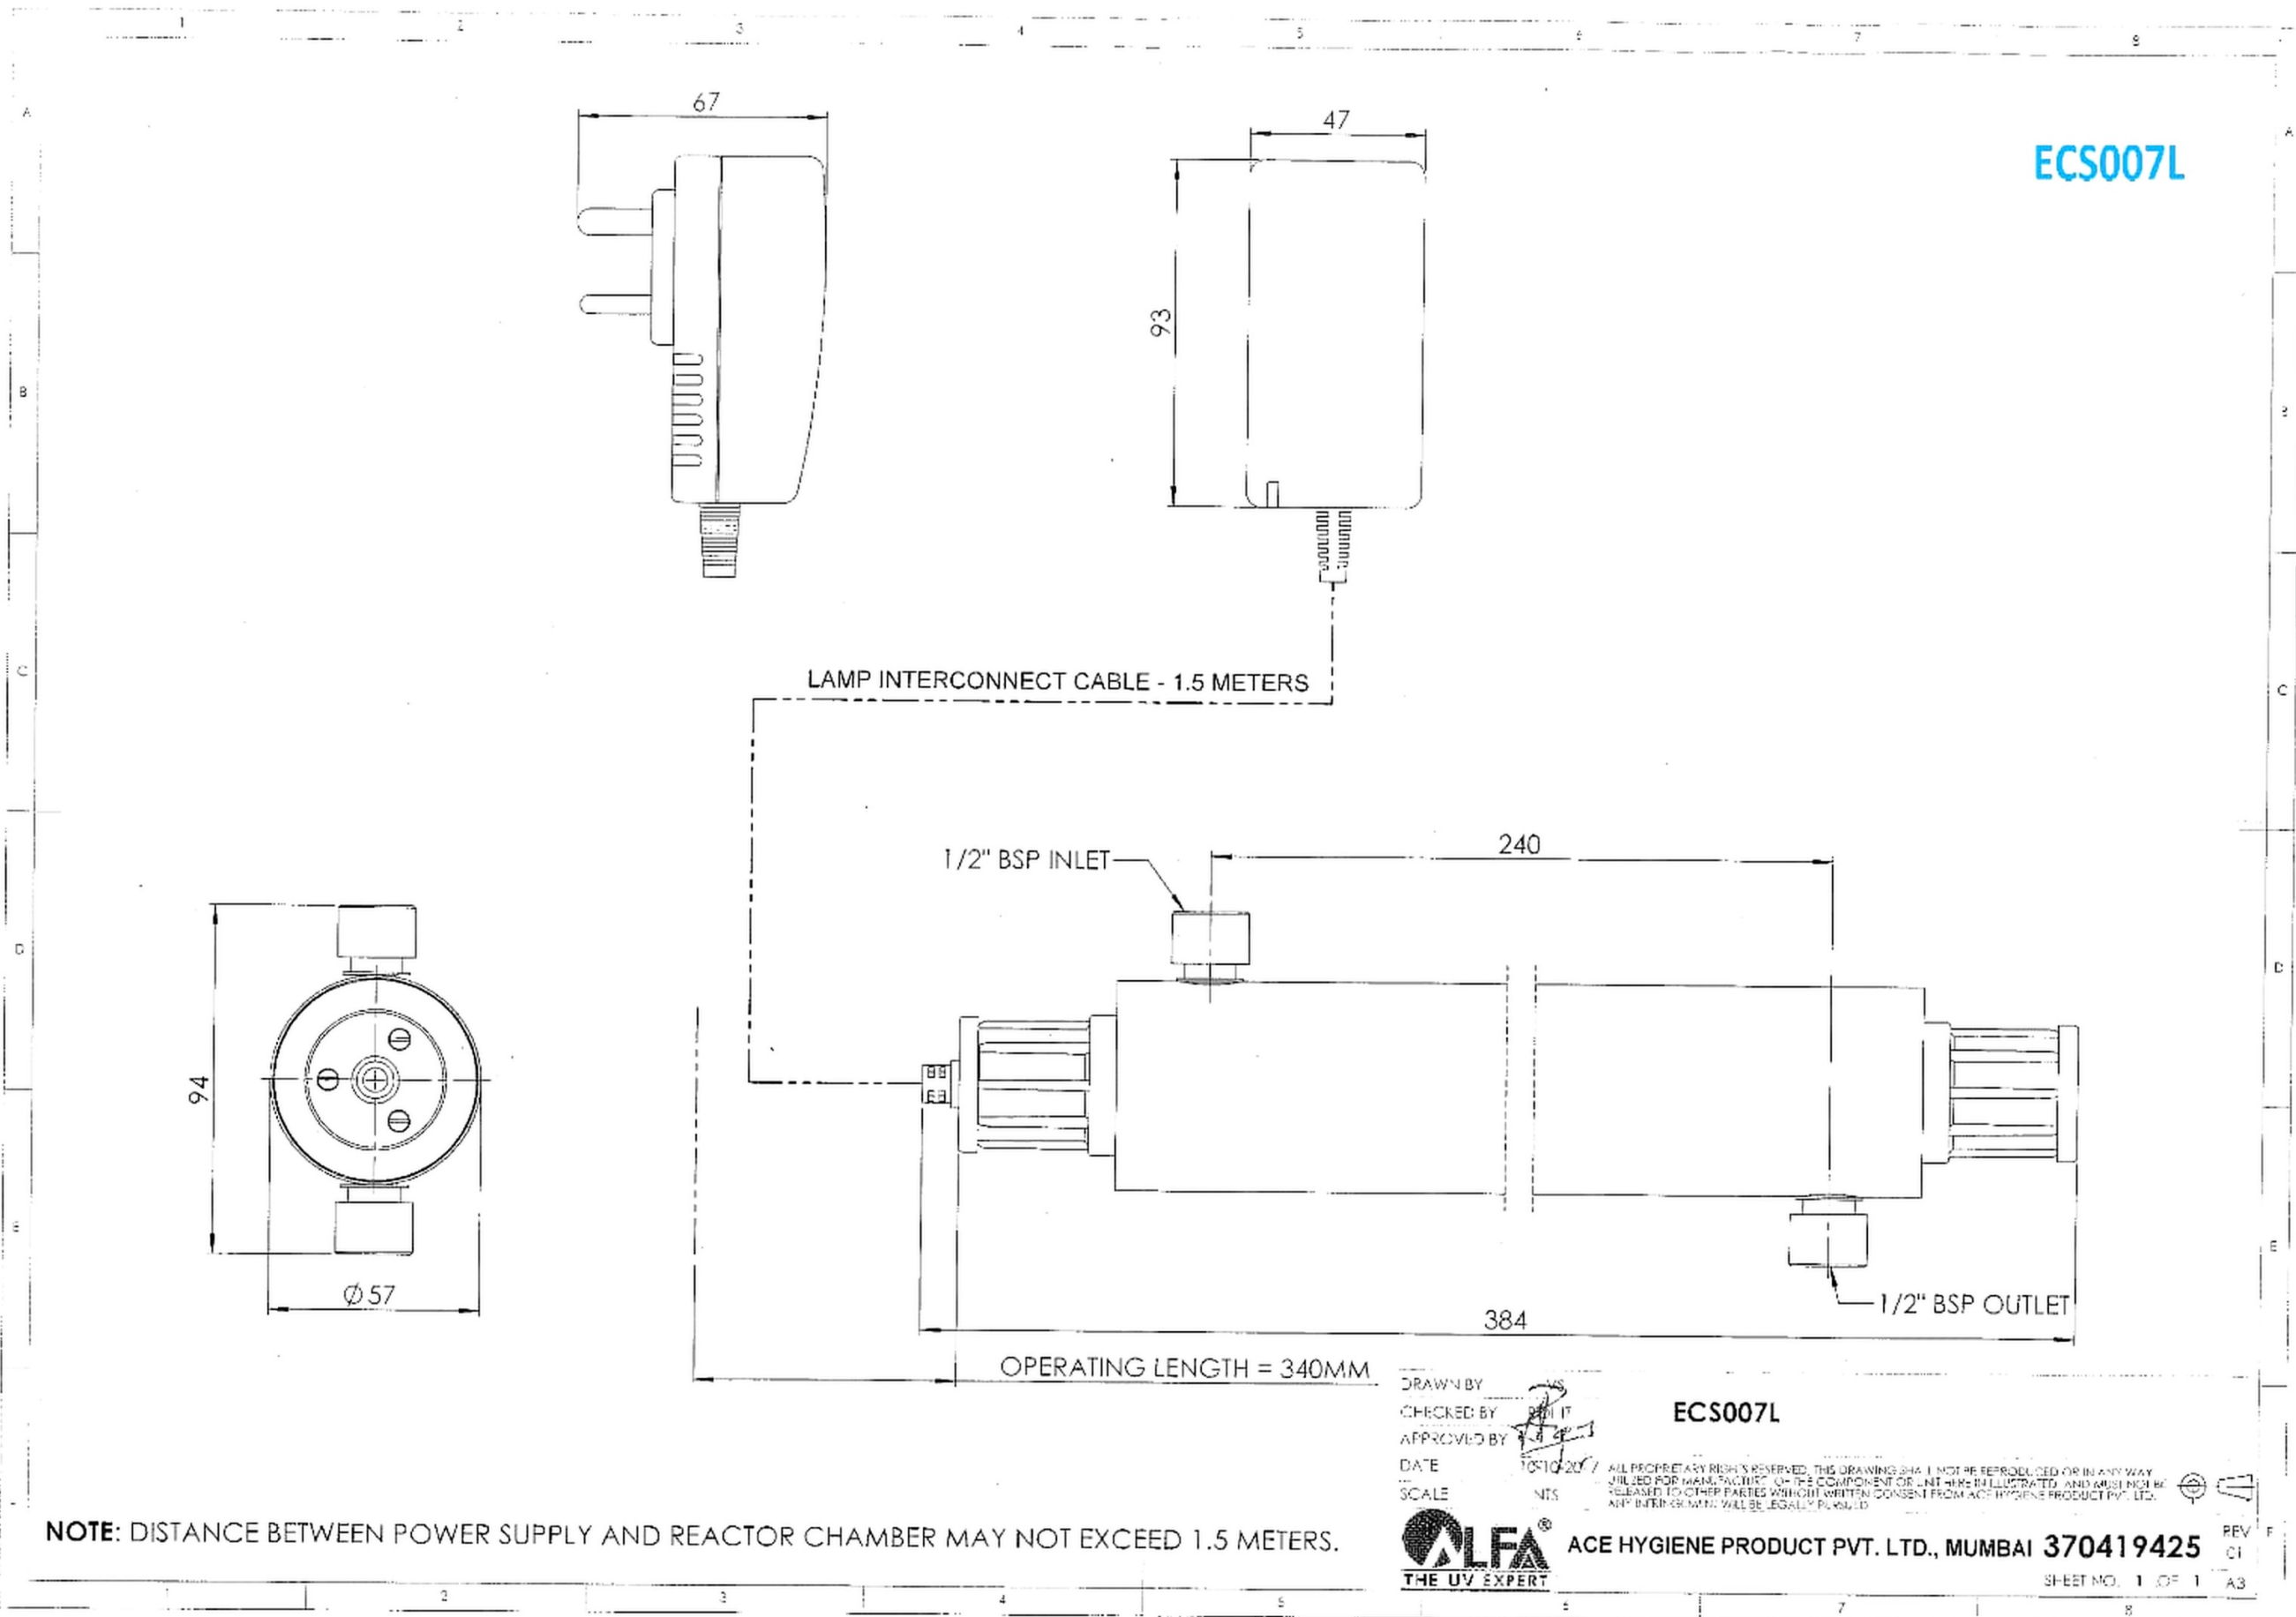

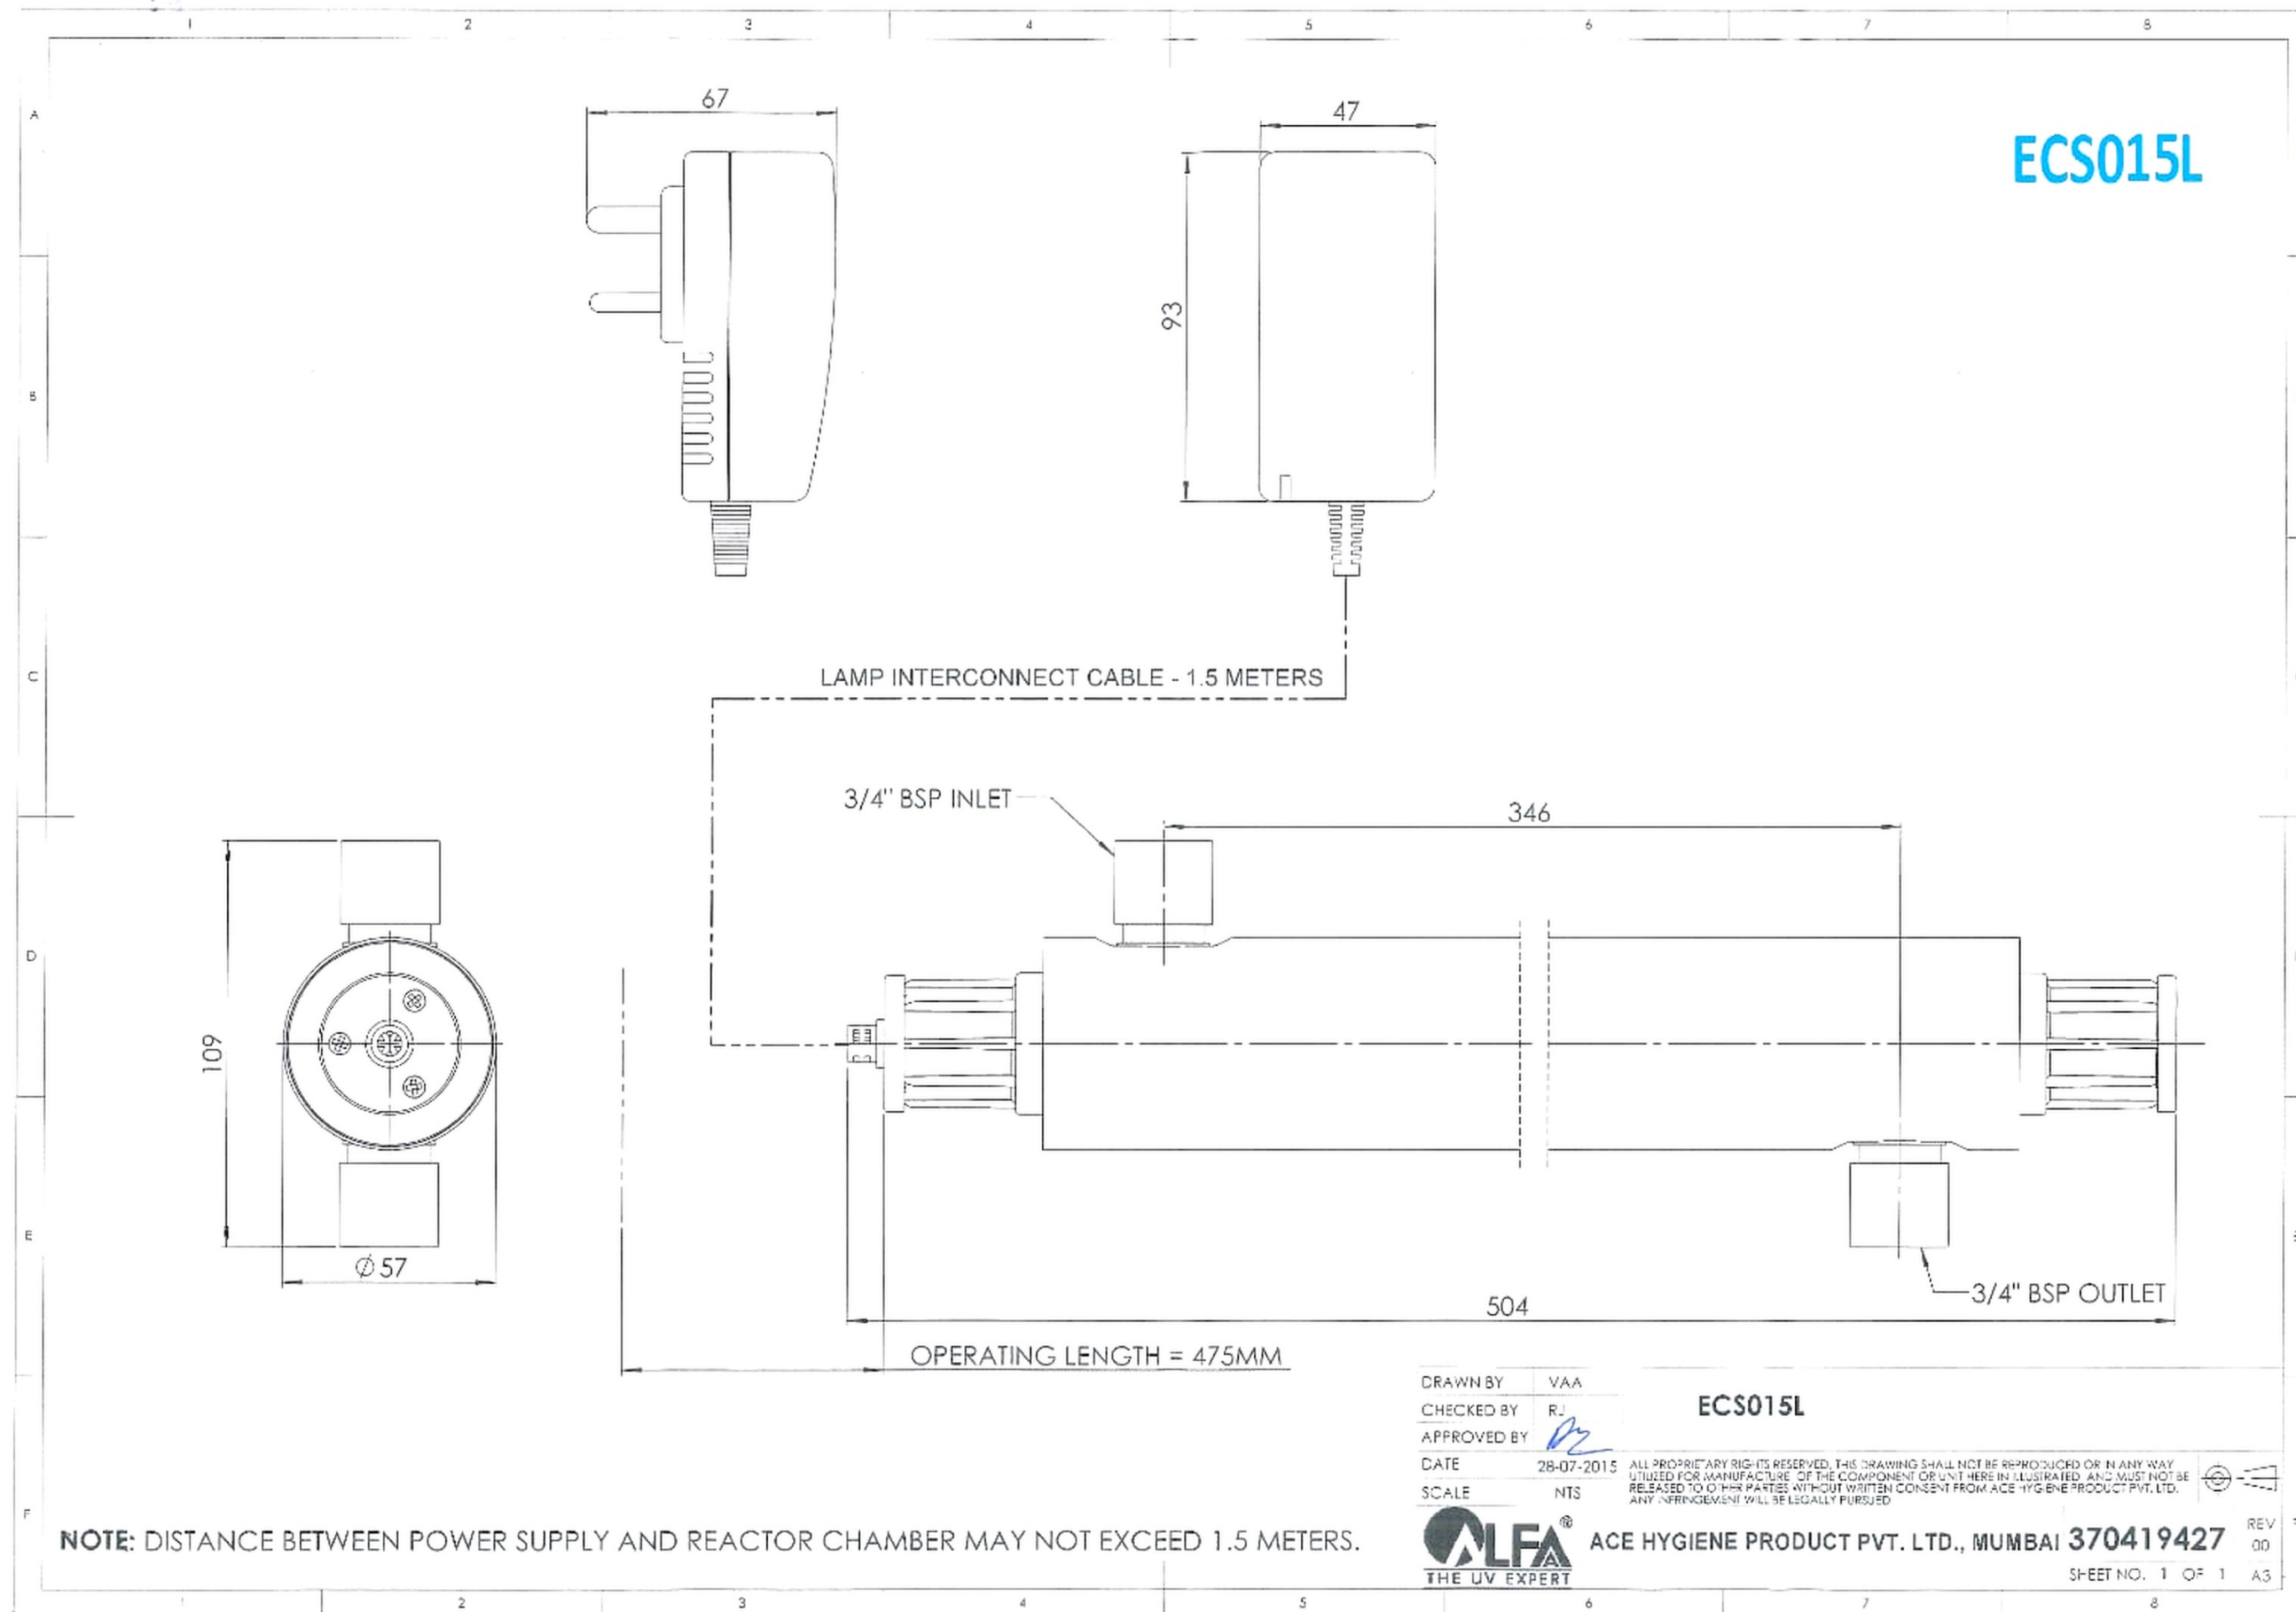

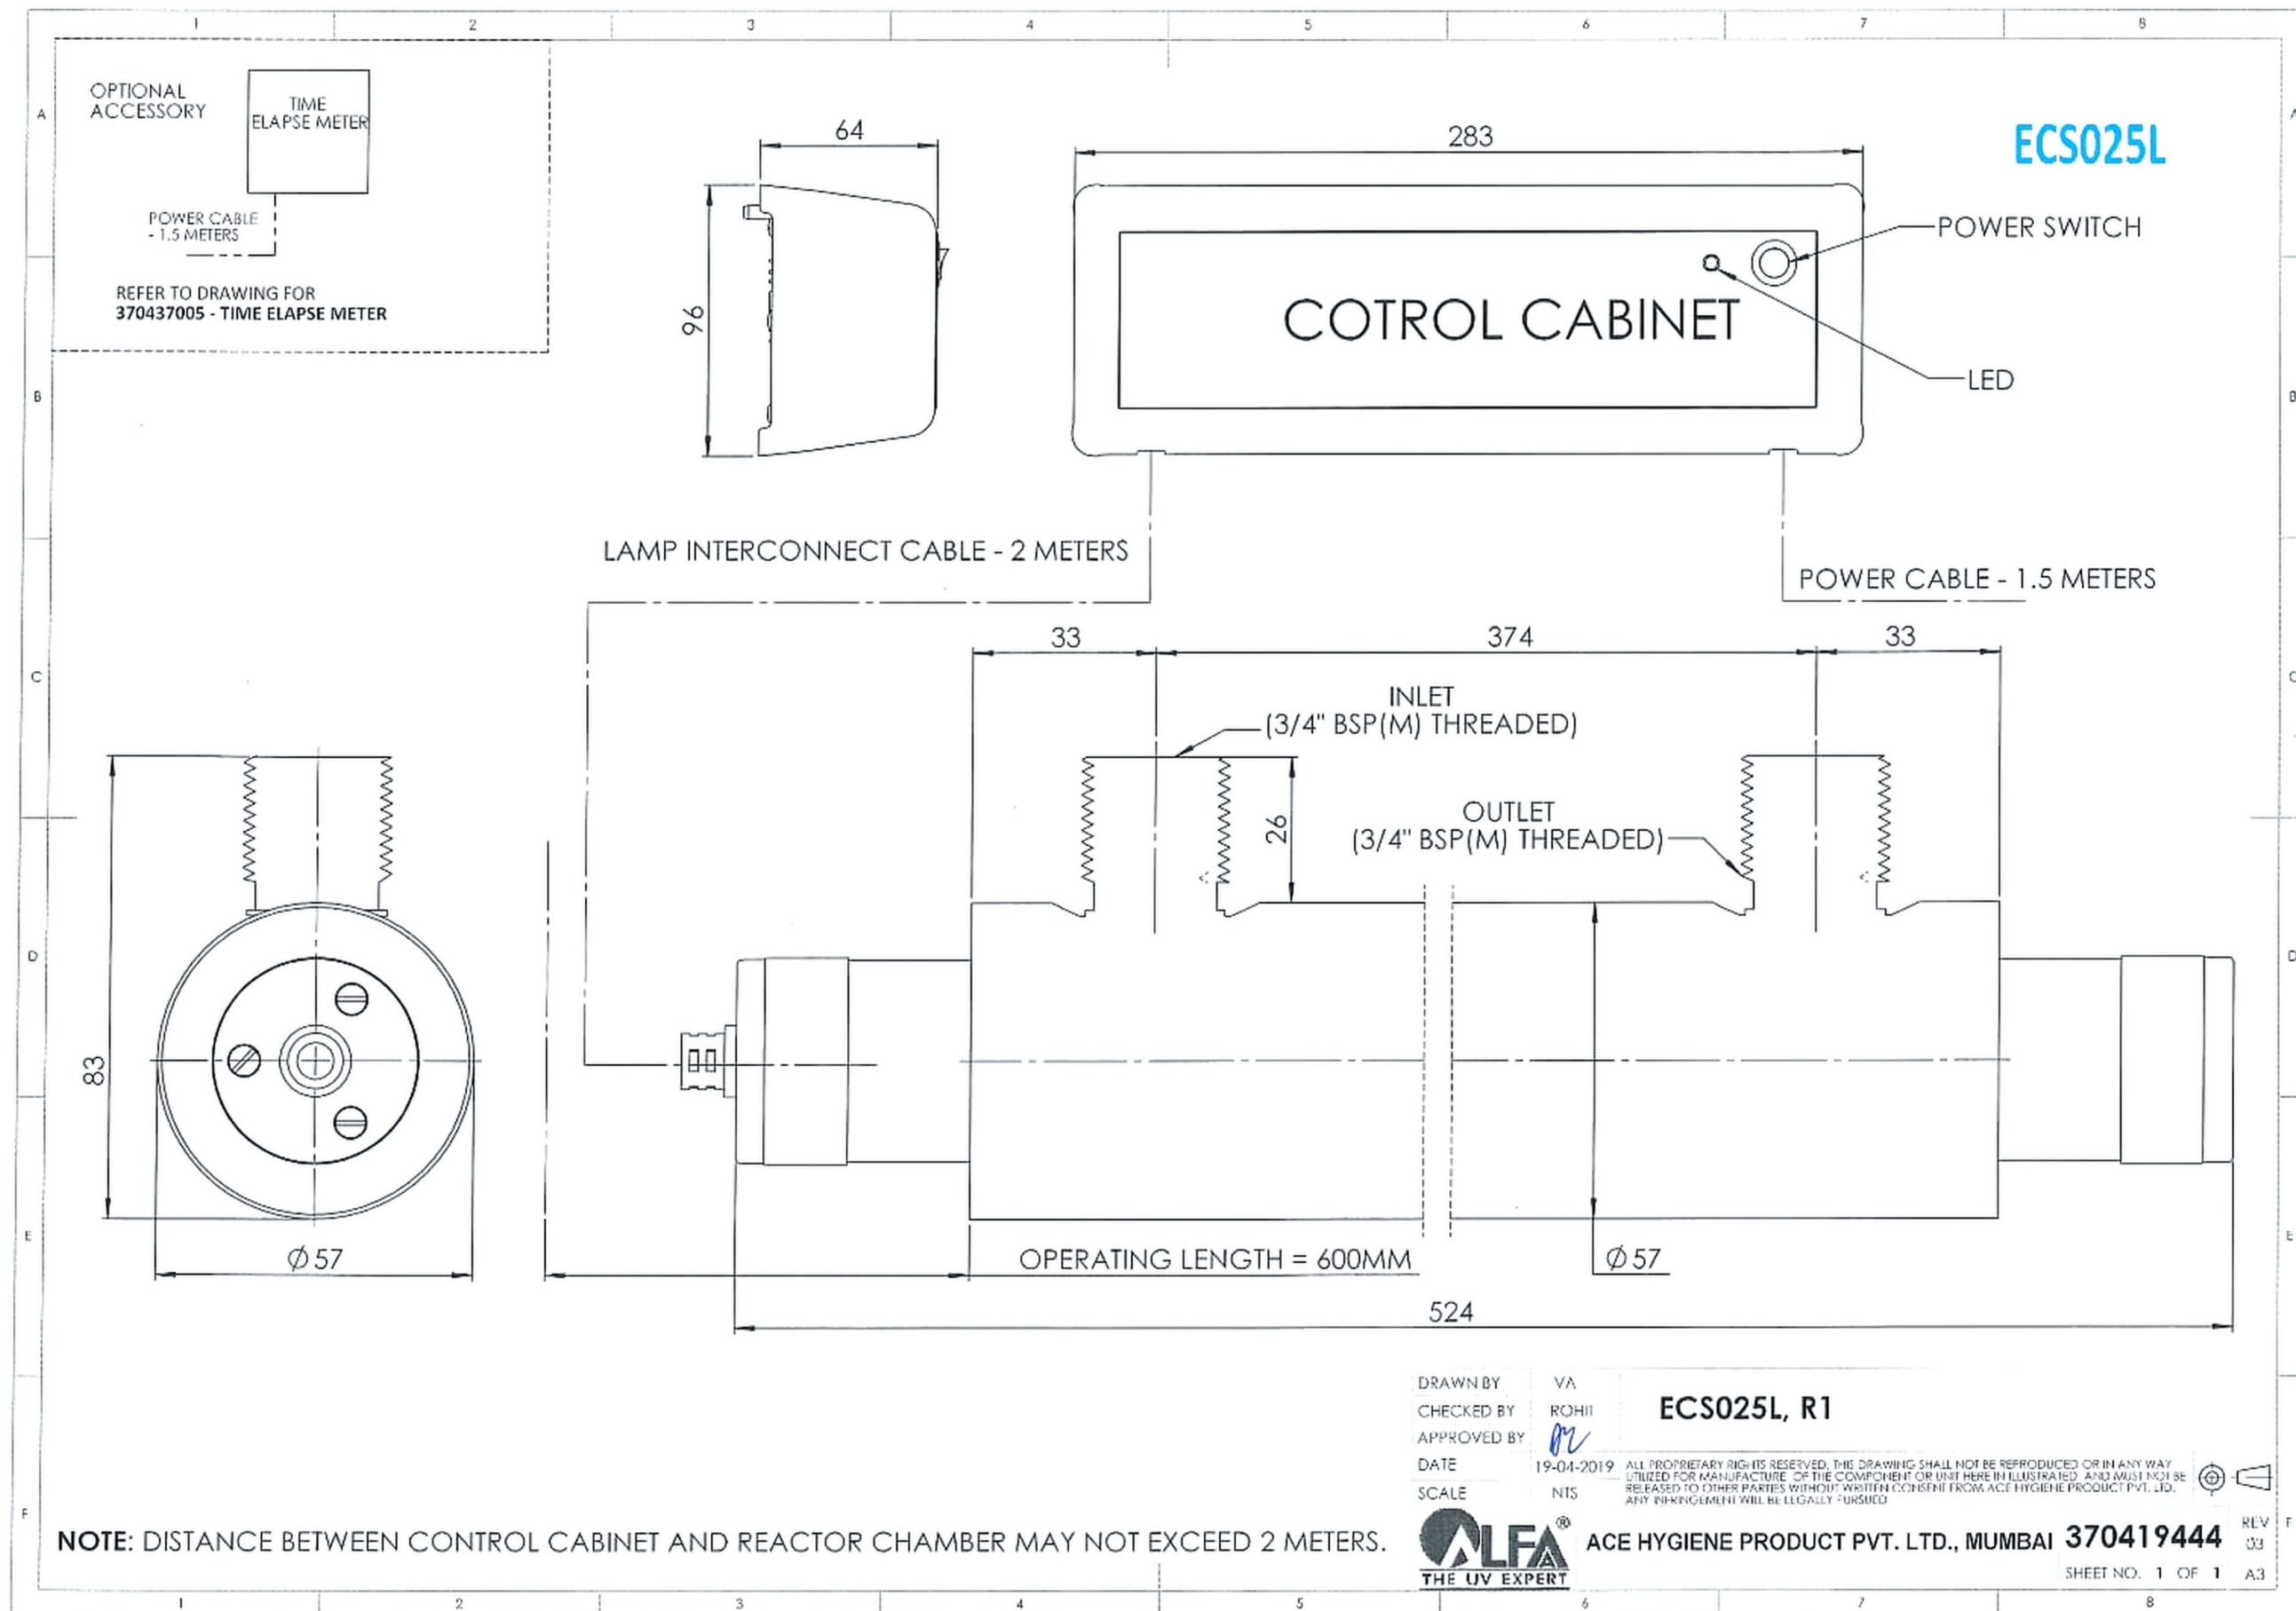

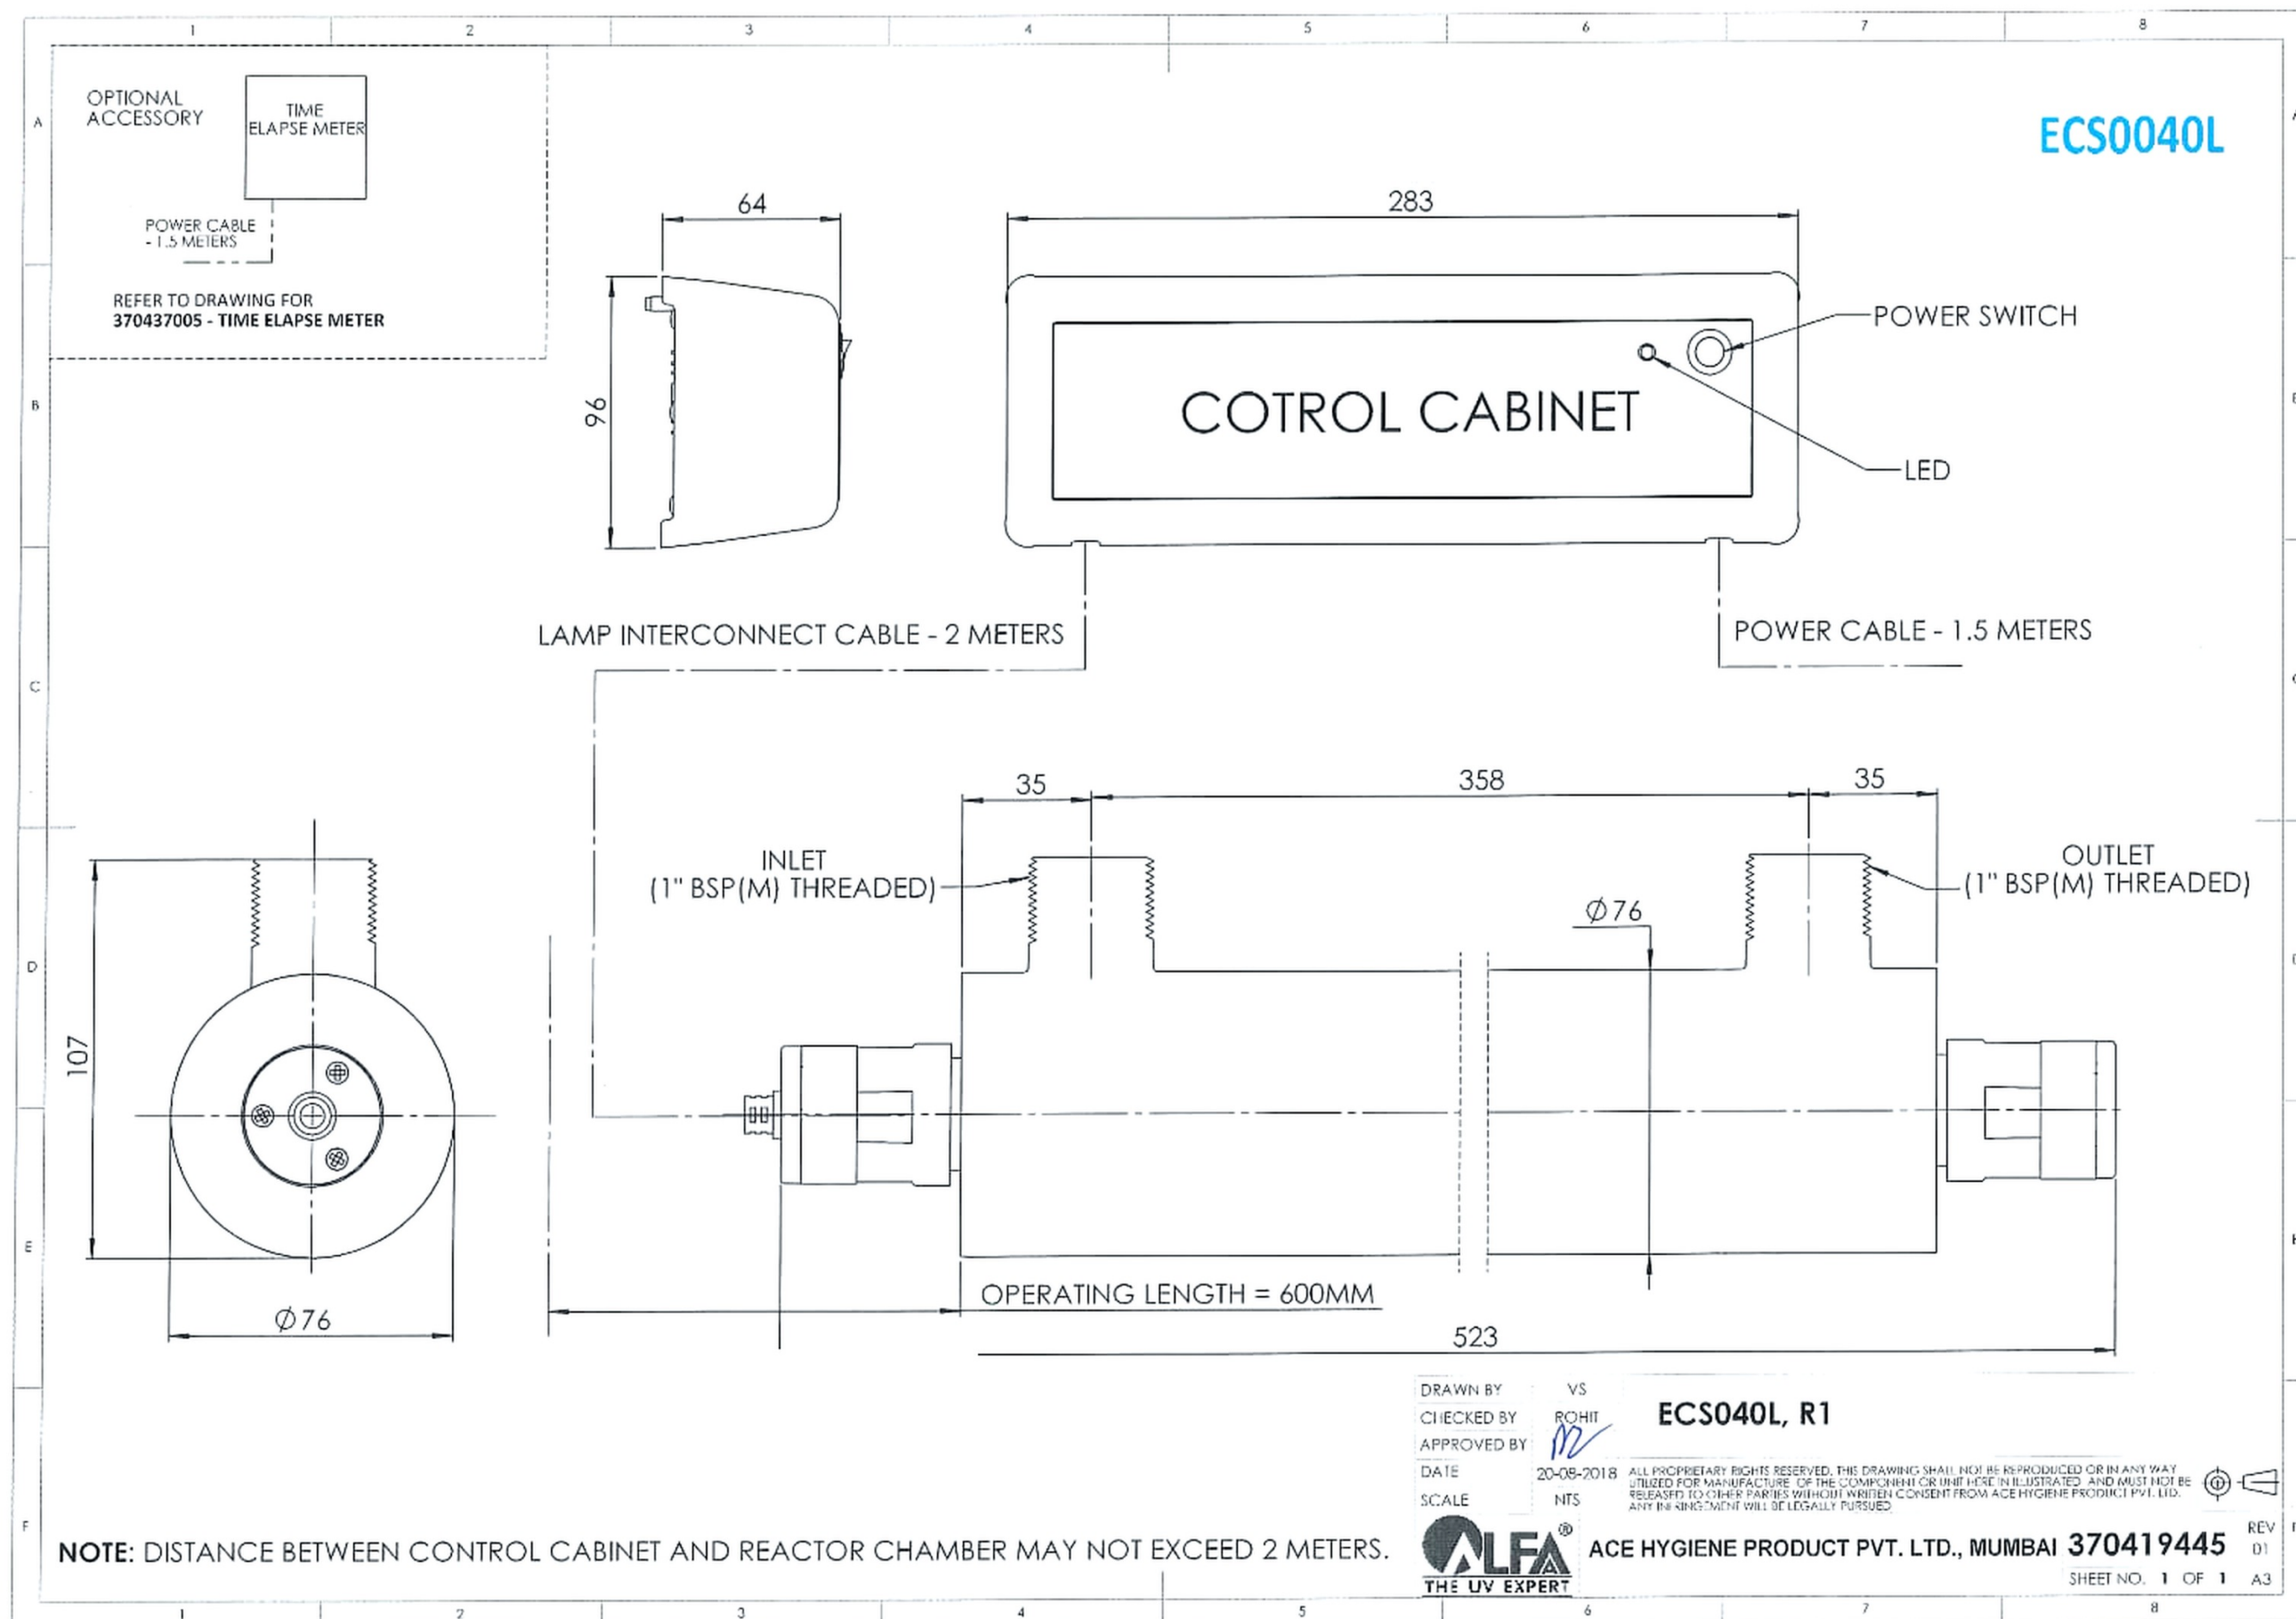



ECS070L

OPTIONAL
ACCESSORY

TIME
ELAPSE METER

POWER CABLE
- 1.5 METERS

REFER TO DRAWING FOR
370437005 - TIME ELAPSE METER

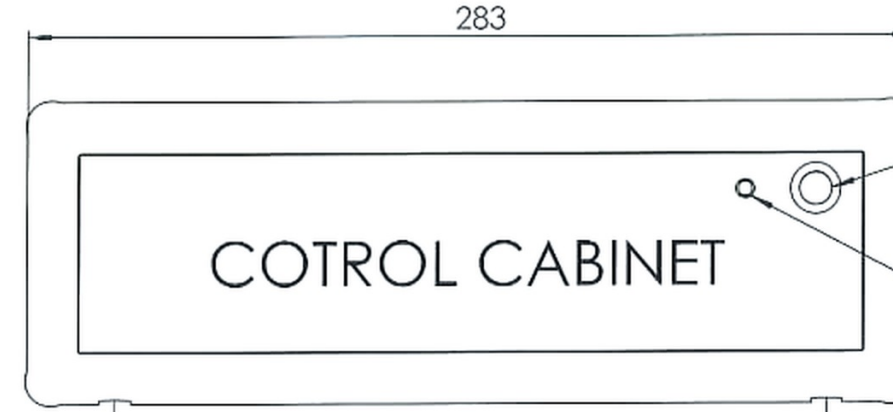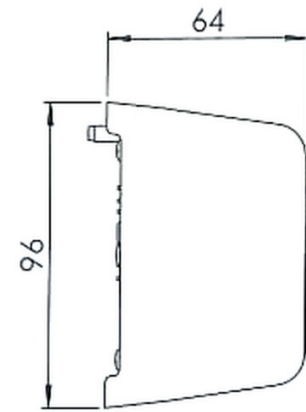



POWER SWITCH

LED

COTROL CABINET

LAMP INTERCONNECT CABLE - 2 METERS

POWER CABLE - 1.5 METERS

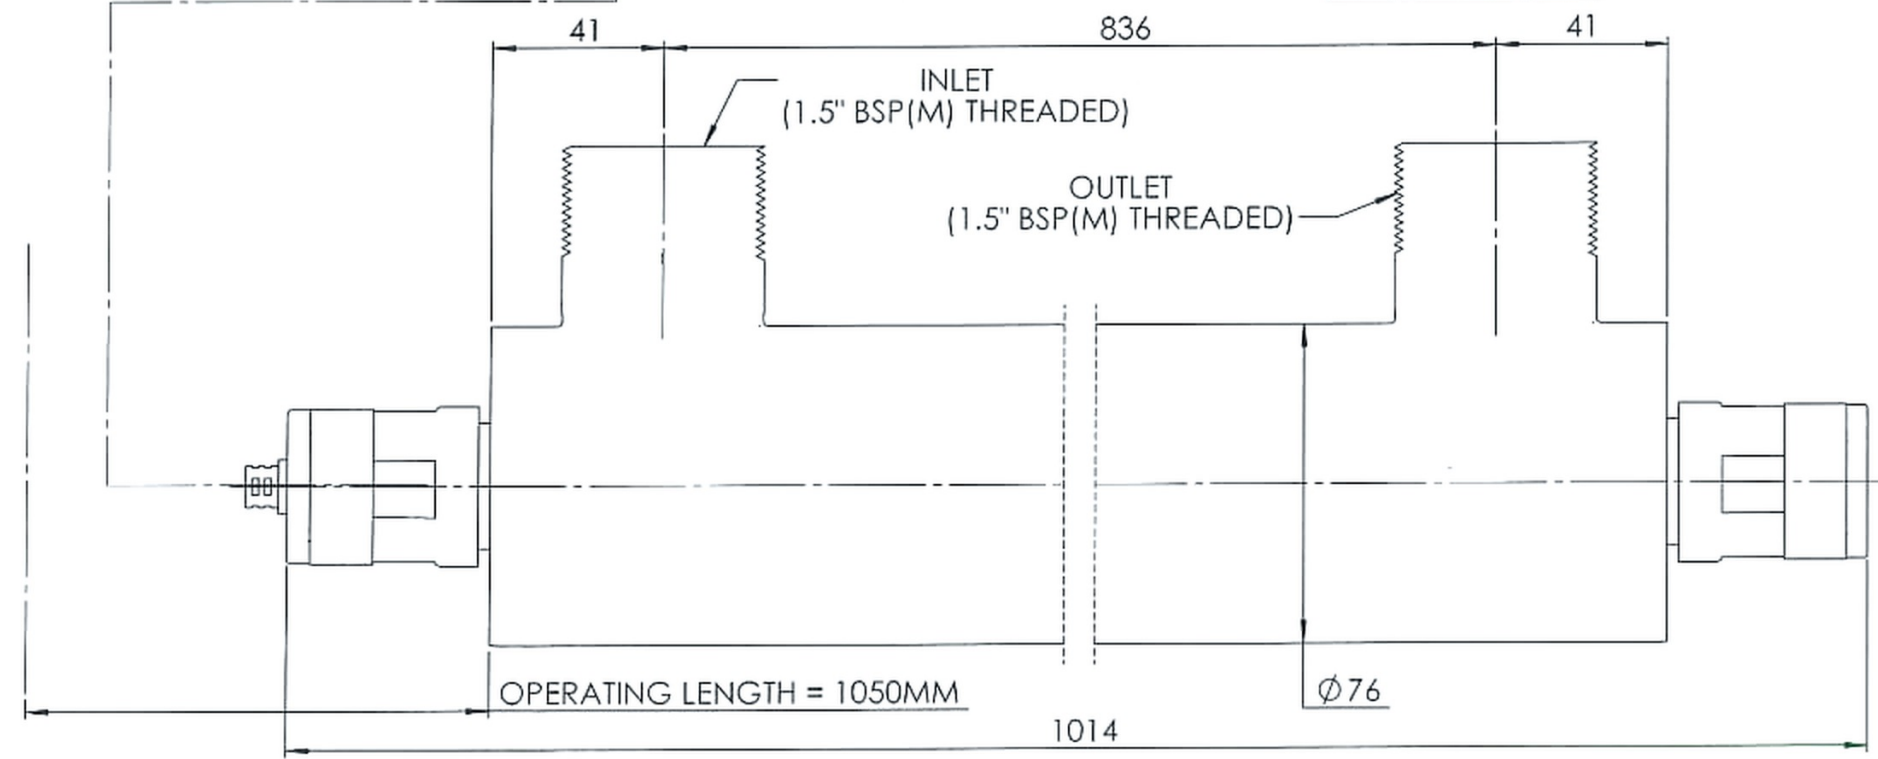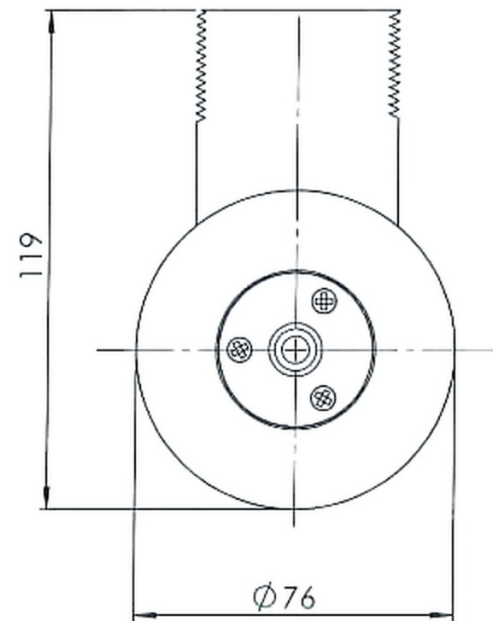

NOTE: DISTANCE BETWEEN CONTROL CABINET AND REACTOR CHAMBER MAY NOT EXCEED 2 METERS.

DRAWN BY VS
CHECKED BY ROHIT
APPROVED BY
DATE 20-08-2018
SCALE NTS

ECS070L, R1



ALL PROPRIETARY RIGHTS RESERVED. THIS DRAWING SHALL NOT BE REPRODUCED OR IN ANY WAY
UTILIZED FOR MANUFACTURE OF THE COMPONENT OR UNIT HERE IN ILLUSTRATED. AND MUST NOT BE
RELEASED TO OTHER PARTIES WITHOUT WRITTEN CONSENT FROM ACE HYGIENE PRODUCT PVT. LTD.
ANY INFRINGEMENT WILL BE LEGALLY PURSUED.

ACE HYGIENE PRODUCT PVT. LTD., MUMBAI 370419446

SHEET NO. 1 OF 1

REV
01
A3

